


500-TK-003 A/B
PROCESS WATER
BUFFER TANKS
CAPACITY: 400 BBL

500-PC-003
WATER TREATMENT
FEED PUMP
CAPACITY: 2.6 GPM (0.6 m³/h.)
ΔP: 50 PSI (3.5 BAR)
HYDRAULIC POWER: 0.14 HP (0.1kW)

500-PK-001
WATER TREATMENT
PLANT
CAPACITY: TBA

500-TK-005
SUMP
CAPACITY: 6ft³ (0.2m³) TBC


500-PC-004
SUMP RECYCLE
PUMP
CAPACITY: 1.5 GPM (0.4 m³/h.)
ΔP: 20 PSI (1.5 BAR)
HYDRAULIC POWER: 0.04 HP (26W)

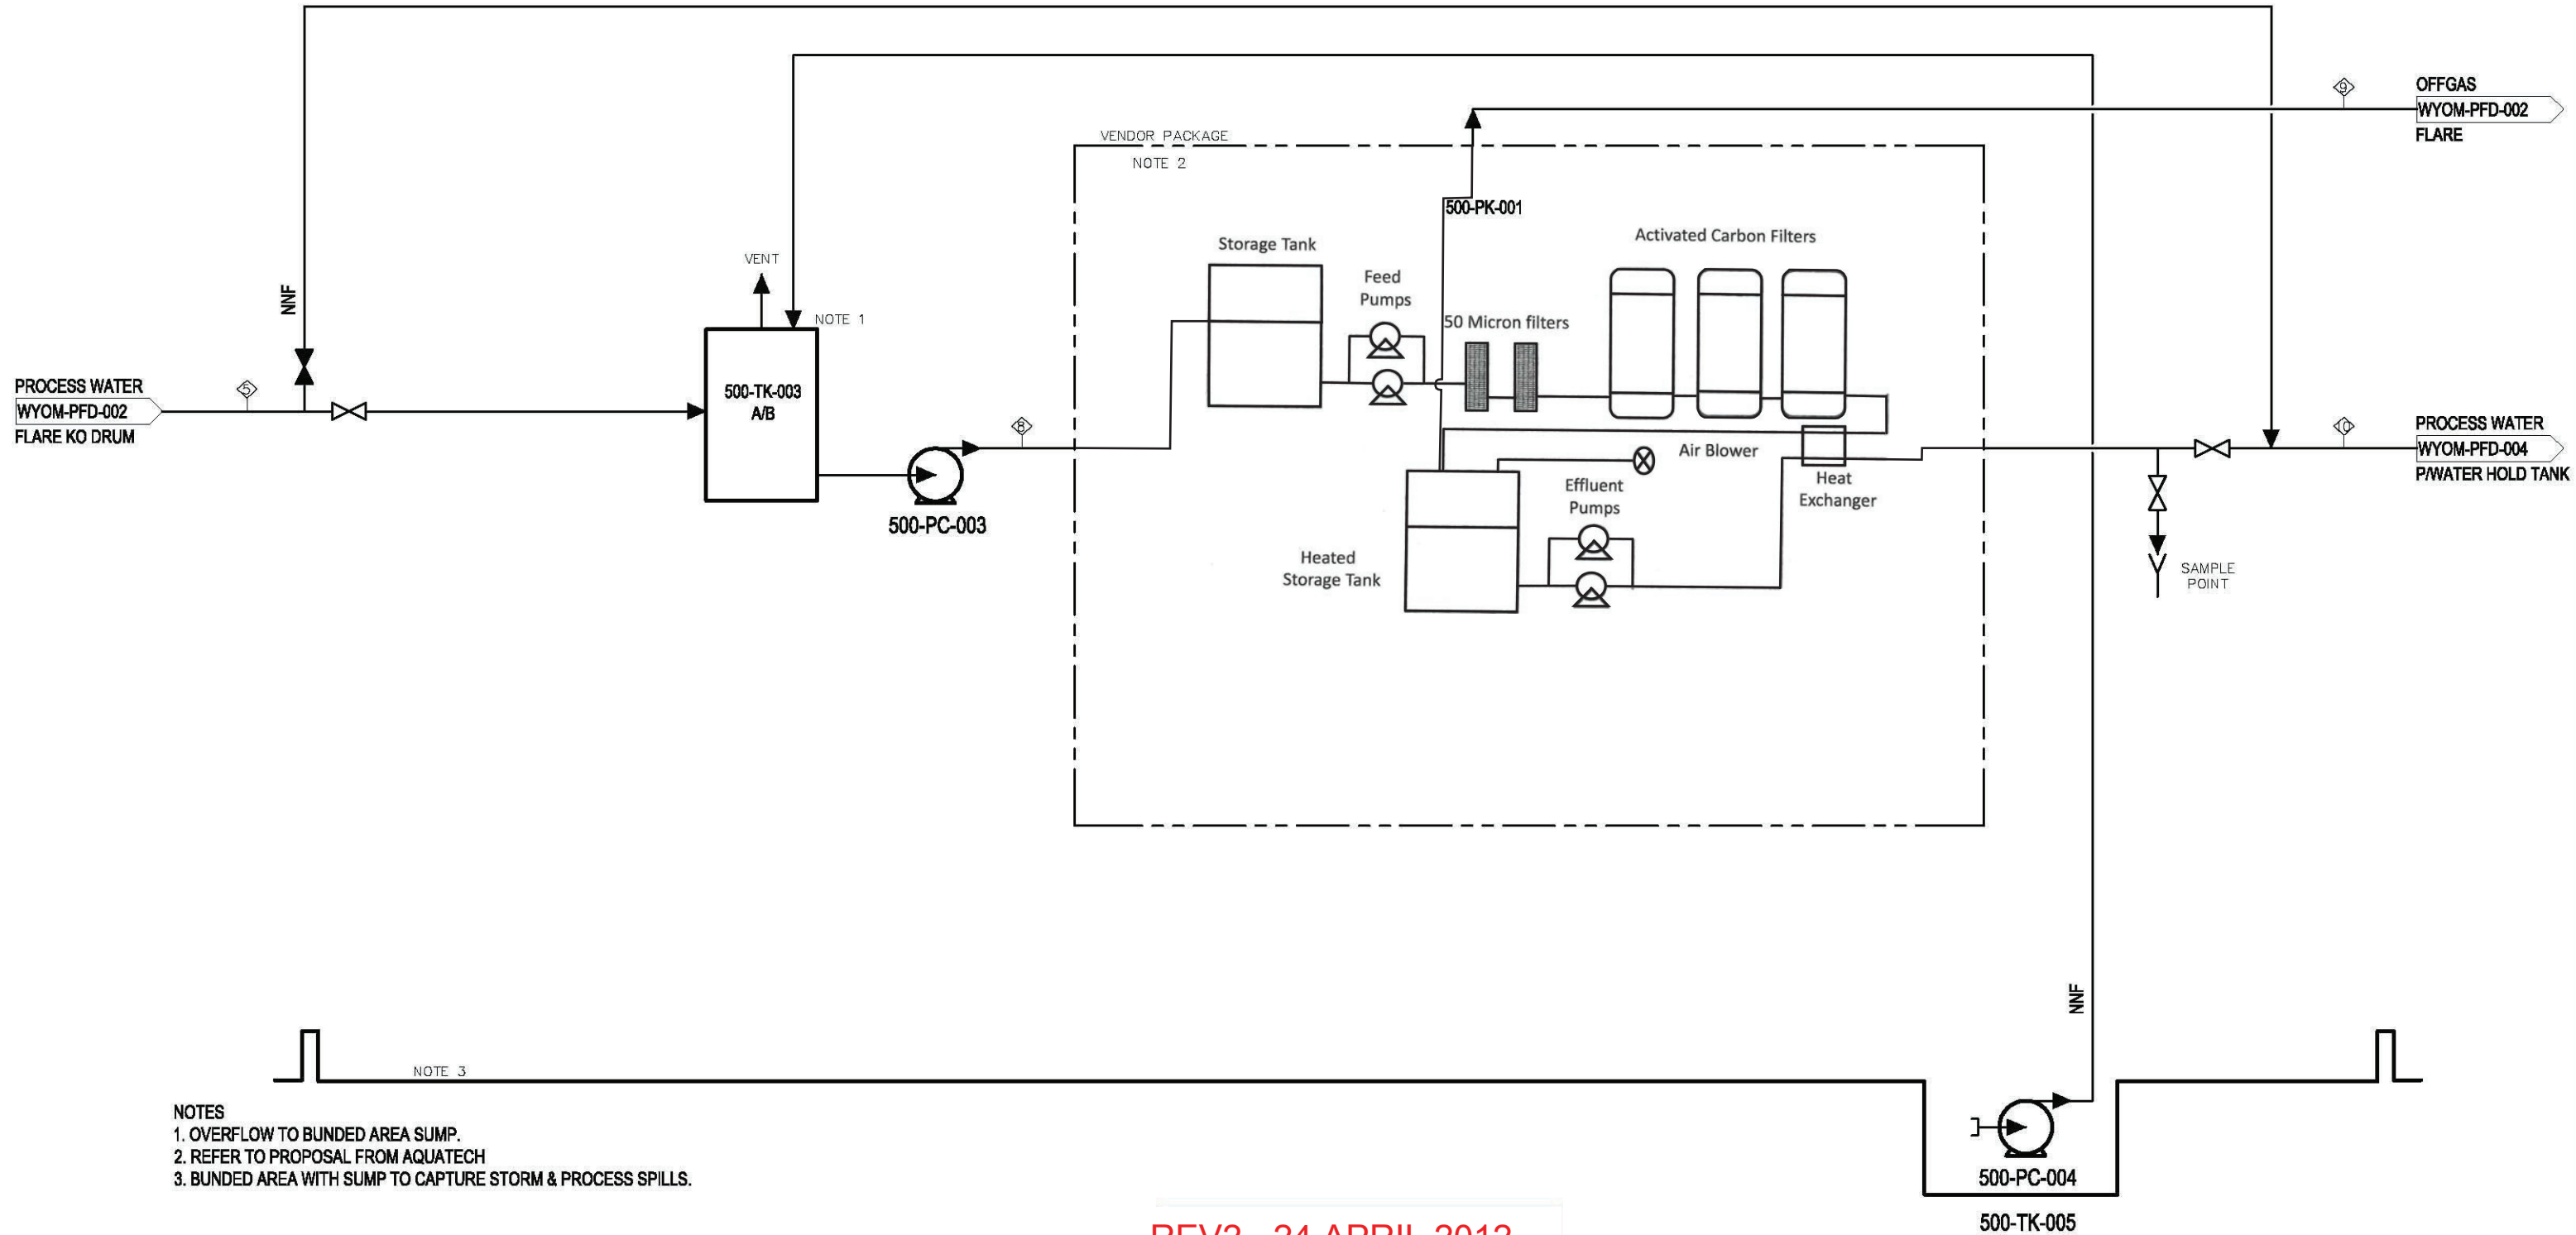

- NOTES
1. OVERFLOW TO BUNDED AREA SUMP.
 2. REFER TO PROPOSAL FROM AQUATECH
 3. BUNDED AREA WITH SUMP TO CAPTURE STORM & PROCESS SPILLS.

REV2 - 24 APRIL 2012

LINC ENERGY PTY. LTD
PROPRIETARY INFORMATION
COMMERCIAL IN CONFIDENCE



No.	REVISION	DATE	DRAWN	DESIGN	APPROVED
2	FOR PERMIT SUBMITTAL	13.4.12	KF	DR	GB
1	UPDATE FROM REVIEW	13.12.11	KF	DR	GB
E	UPDATE TO CURRENT SCOPE	22.9.11	KF	-	GB
D	AMENDED	28.2.11	KF	SDL	GB
C	RENAMED-WAS WYOM-002-02	23.2.11	KF	SDL	GB



SCALE	SITE	FILE No.	REV No.
NTS	CAMPBELL COUNTY, WYOMING, USA.	-	3
DRAWN: Kyle Fysh	TITLE: WYOMING DEMO PROJECT (GASIFIER 6) WATER TREATMENT PROCESS FLOW DIAGRAM DESIGN CASE: NORMAL	DWG No.	WYOM-PFD-003
DATE: OCT 2010			
CHECKED: -			
DESIGNED: Grant.Bollaert			
APPROVED: G.HARRIS			

Figure 14-6